



GENERAL NOTES:

1. WHERE CONCRETE MASONRY UNIT (C.M.U.) PRIVACY WALLS OR RETAINING WALLS ARE INSTALLED, WEEP HOLES SHALL BE PROVIDED IN THE PORTION OF THE WALL BELOW GRADE, TO RELIEVE POTENTIAL HYDROSTATIC PRESSURE. WEEP HOLES SHALL BE 2" PVC AT 32" O.C. NO TURNED BLOCKS WILL BE ALLOWED.
2. WALL DESIGN PER ENGINEER OF RECORD.
3. WHEN DISCHARGE THROUGH CMU WALLS IS FOR THE PURPOSE OF METERING STORM WATER RUNOFF THE SIZE OF THE CMU WALL PENETRATION SHALL BE SPECIFIED BY THE ENGINEER OF RECORD. THE GENERAL DETAIL SHALL HAVE ALL THE COMPONENTS SHOWN ON THIS DRAWING.
4. STORM WATER DISCHARGE SCOUR PROTECTION SHALL BE PROVIDED. MIN. RIPRAP REQUIREMENTS ARE 2 TIMES PENETRATION WIDTH CENTERED ON PENETRATION. RIPRAP SIZE, DEPTH AND LENGTH SHALL BE DESIGNED BY THE ENGINEER OF RECORD.
5. THIS IS NOT AN ENGINEERED DESIGN.

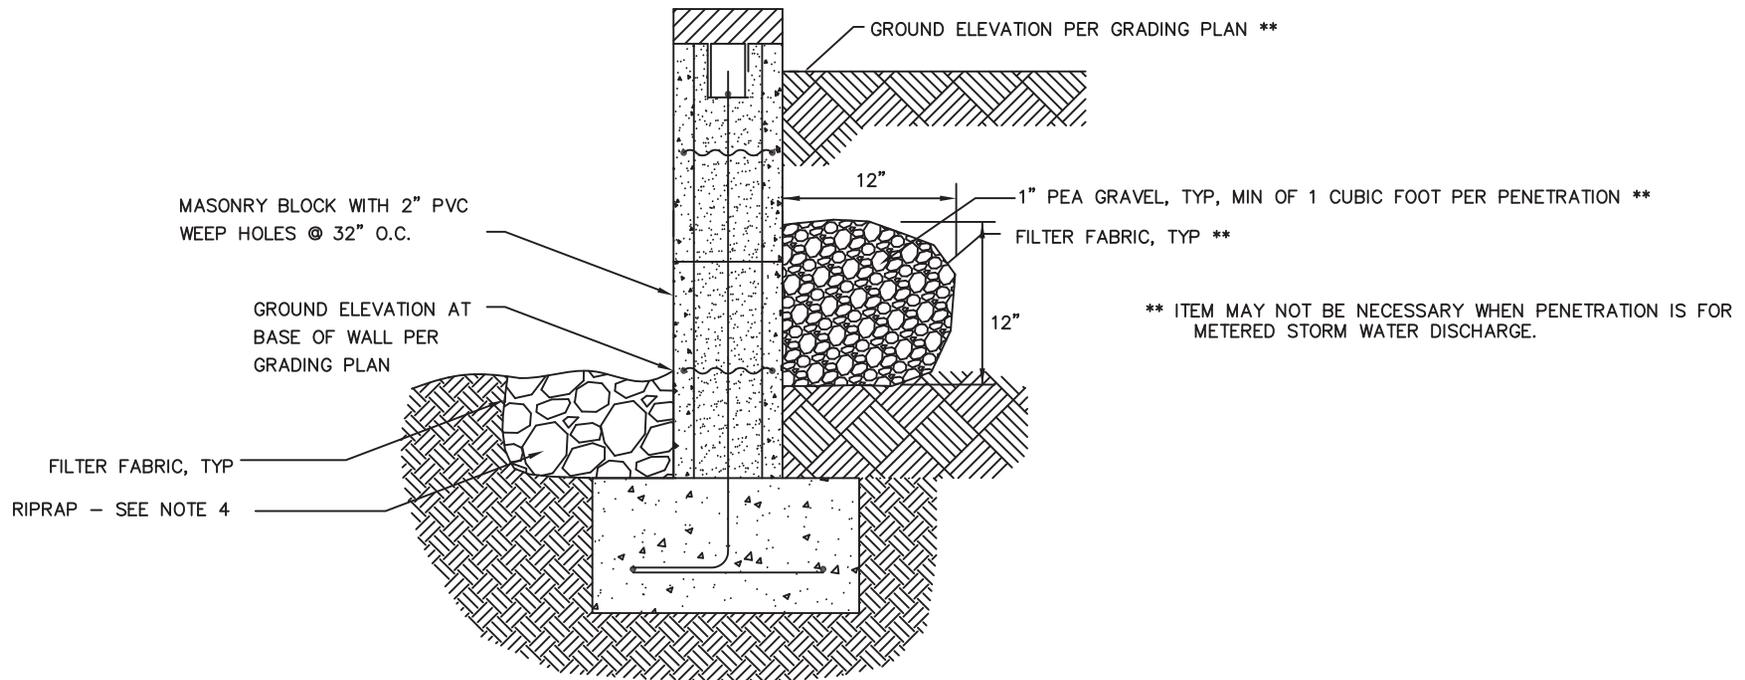

City of Rio Rancho  
Department of Public Works

CMU WEEP HOLES AND STORM WATER  
PENETRATIONS

DATE MODIFIED: JUN 22, 2015

DWG. NO. DR-01

JUN 30, 2009