



PLAN  
TYPICAL ENCLOSURE INSTALLATION  
SCALE: NTS

GENERAL CONSTRUCTION NOTES:

1. ENCLOSURE MODEL, CONSTRUCTION, AND MAINTENANCE IS THE RESPONSIBILITY OF THE CUSTOMER, NOT THE CITY OF RIO RANCHO.
2. ENCLOSURE MUST BE INSULATED. THE RECOMMENDED FREEZE PROTECTION METHOD IS A POSITIVE HEAT SOURCE, PIPING INSULATION, AND APPROVED ENCLOSURE.
3. ENCLOSURES MUST BE INSTALLED SO THAT THE BACKFLOW PREVENTION ASSEMBLY CAN BE SAFELY ACCESSED FOR TESTING, MAINTENANCE, AND REPAIRS.

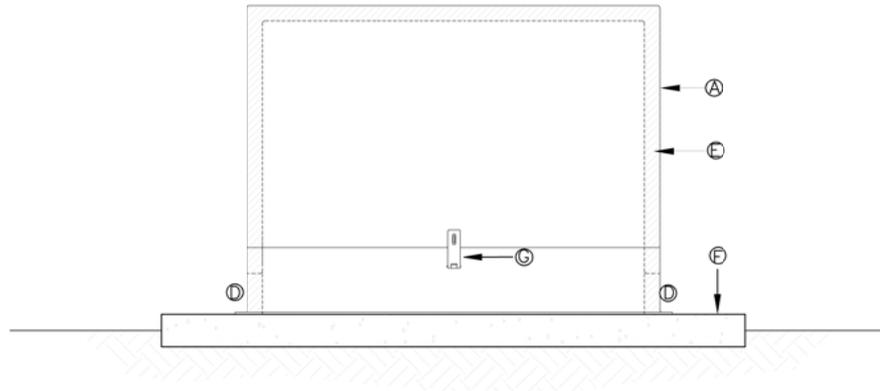

ELEVATION  
TYPICAL ENCLOSURE INSTALLATION  
SCALE: NTS

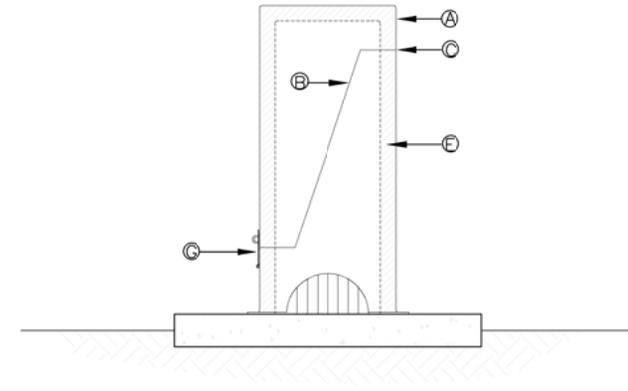


END VIEW  
TYPICAL ENCLOSURE INSTALLATION  
SCALE: NTS

KEYED NOTES:○

- A. ENCLOSURE
- B. LID
- C. HINGE
- D. DRAIN PORT
- E. INSULATION, MINIMUM 1.5-INCHES THICK
- F. SINGLE ANCHOR PAD, 4 PLACES
- G. LOCKING STAPLE, TO PROTECT AGAINST THEFT AND VANDALISM
- H. FOR RECOMMENDED SLAB SIZE ADD 9-INCHES TO THE ENCLOSURE EXTERIOR

DATE MODIFIED:

OCTOBER 2017



City of Rio Rancho  
Department of Public Works

TYPICAL ENCLOSURE

DWG. NO. W-04

APRIL 22, 2016